



APT-8S / APT-9S

WEEKLY PROGRAMMABLE TIMER

User's Manual

SAFETY PRECAUTION This manual uses the following symbols to ensure safe operation of this timer.

- ⚠ WARNING** Warnings are indicated when mishandling this controller might result in death or serious injury to user.
- ⚠ CAUTION** Cautions are indicated when mishandling this controller might result in minor injury to the user, or only physical damage to the timer.

⚠ WARNING

- Note this incorrect wiring of this controller can damage it and lead to other hazards. Make sure the controller has been correctly wired before turning the power ON.
- Before wiring, or removing / mounting the controller, be sure to turn the power OFF. Failure to do so might cause electric shock.
- Do not touch electrically charged parts such as the power terminals. Doing so might cause electric shock.
- Do not disassemble the controller. Doing so might cause electric shock or faulty operation.

⚠ CAUTION

- Use the controller within the operating ranges recommended in the specification (temperature, humidity, voltage, shock, mounting direction, atmosphere and etc.). Failure to do so might cause fire or faulty operation.
- Firmly tighten the terminal screws. Insufficient tightening of terminal screws might cause electric shock or fire.

RESTRICTIONS ON USE

When using this product in applications that require particular safety or when using this product in important facilities, please pay attention to the safety of the overall system and equipment. Install fail-safe mechanisms, perform redundancy checks and periodic inspections and adopt other appropriate safety measures when it is necessary.

SPECIFICATIONS		BUTTON and SWITCH FUNCTIONS	
Operating voltage	AC/DC : 12 ~ 48V / AC/DC : 100 ~ 240V	• DAY : Weekday setting	• +1H : Daylight-saving-time setting
Allowable operating voltage range	85 ~ 110% of rated operating voltage	• HR : Hour setting	• MAN : Mandatory contact enable or disable
Rated frequency	50 / 60 Hz	• MIN : Minute setting	• RESET : Program reset
Contact rating	250VAC 10A (Resistive load)	• SEC : Second setting	• TIMER : Timer mode
Indicator operating	POWER - Red / RELAY ON - Green	• MODE : Mode status selecting	• PULSE : Pluse mode
Power consumption	Approx. 3.3VA	• PROG. : Program number setting	• min : Unit of minute (in TWIN TIMER)
Life	Mechanical : 5,000,000 times / Electrical : 100,000 times	• START : Normal mode setting	• sec : Unit of second (in TWIN TIMER)
Ambient temperature	-10 ~ +50 °C	• CLEAR : Clear setting	• ON : Power on (Battery on)
Ambient humidity	MAX 85% RH	• 12/24H : 12H or 24H setting	• OFF : Power off (Battery off)
Weight	Approx. 170g		

OPERATING FLOWCHART


CLOCK MODE



NORMAL MODE




PROGRAM MODE (Choose ONE method ONLY)

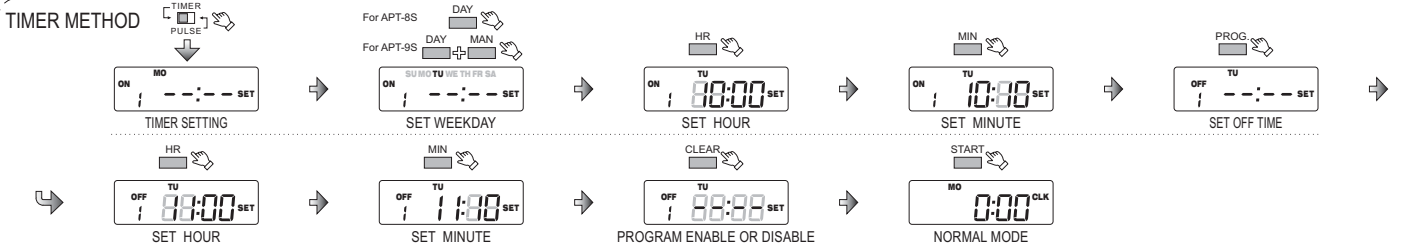

Setting example :

There is a machine needed to be turned on at 8:00 AM and to be turned off at 5:00 PM, from Monday to Friday. In addition, the machine needed to be turned on at 9:00 AM to 11:00 AM every Saturday for inspection. The correct setting display should be as follows.

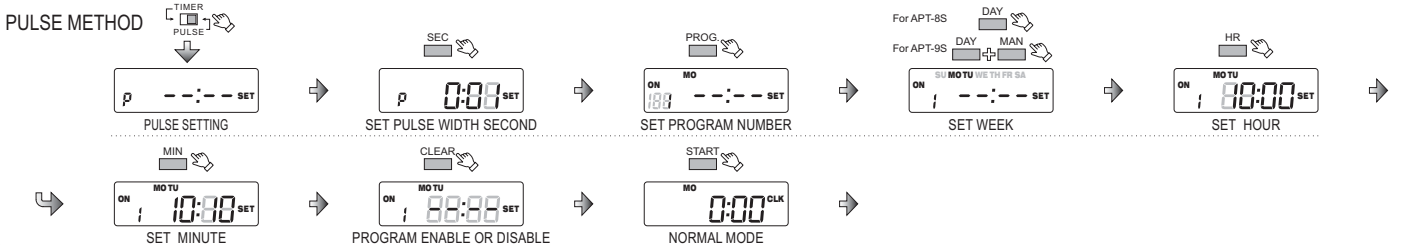

Setting example :

The factory has a buzz to remind workers their business hours, break time and etc. The buzz should be activated at 8:00, 12:00, 13:00, and 17:00 from Monday to Saturday. The buzz should be activated 10 seconds every time. The correct setting display should be as follows.




4

CHANGE TO THE HOLIDAY SUSPENSION MODE

HOLIDAY SUSPENSION MODE

(You may skip this step and setup this function later.)



Setting example :

9 days holiday suspension from Saturday




5

CHANGE TO THE TWIN TIMER MODE

TWIN TIMER MODE

(You may skip this step, if you do not need this function. Please be noticed, when twin timer function is enabled, the program will be disabled.)

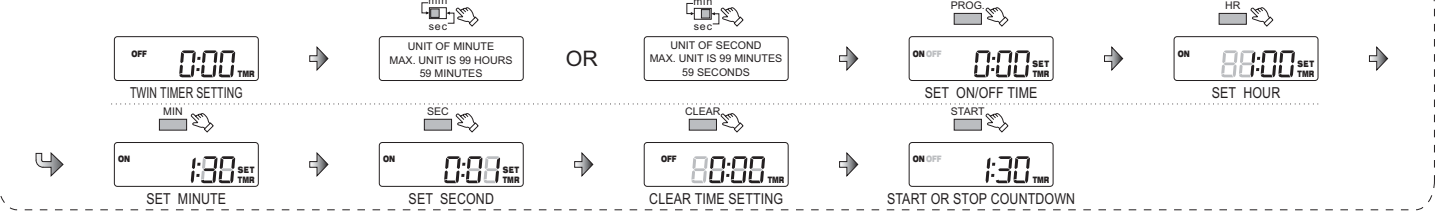

BACK TO THE CLOCK MODE


CONNECTION

POWER BACKUP FEATURE


When a time switch and load power supply are separate.

When a time switch and load power supply are the same.


N Type

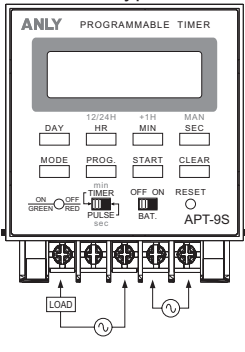


N Type

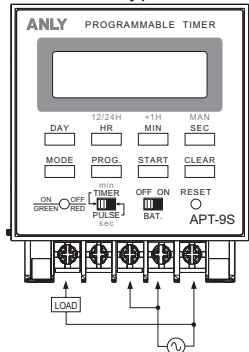

The timer retains clock operation and program memory when external power fail. With external power failure, the contact position will be held in OFF position until the power is restored. (See right chart) The program will stay ON regardless of the external power failure. (When program setting is ON) However, when external power is restored, it also restores contact status.





PROGRAM OVERLAPPING TIMEING CHART

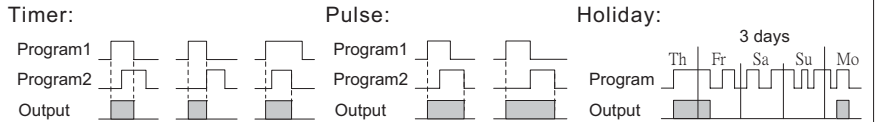

BATTERY CHANGE

CONVERT Y TYPE (Flush Mounting) TO N TYPE (Surface Mounting)

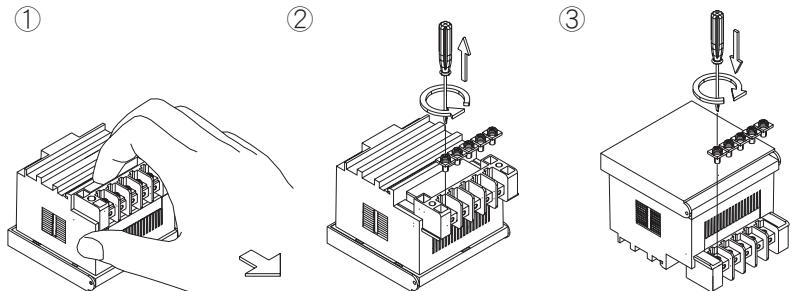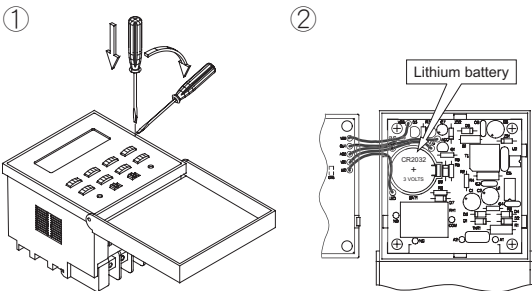

CONVERT N TYPE (Surface Mounting) TO Y TYPE (Flush Mounting)

